

EVACUATION PLAN



DATE ISSUED:

10/2014

DIAGRAMS USED ON THIS DRAWING ARE NOT TO SCALE

RESPONSE TO AN EMERGENCY



STAGES OF EVACUATION

EVACUATION SHOULD BE CONDUCTED IN THREE DISTINCT STAGES DEPENDING ON THE SEVERITY OF THE INCIDENT

STAGE 1 - REMOVAL OF PERSONS FROM THE IMMEDIATE DANGER AREA

Occupants are removed from the affected compartment to the next compartment eg. from a room into a corridor. Doors should be closed to confine smoke and fire to affected compartment.


STAGE 2 - REMOVAL TO A SAFE AREA

If the severity of smoke and heat warrants further evacuation, occupants and visitors should be moved to a safe place on the same level.

STAGE 3 - COMPLETE EVACUATION OF THE FLOOR

Should the emergency necessitate evacuation of the affected floor, Wardens are to direct occupants to the assembly area via emergency exits.

ASSEMBLY AREA

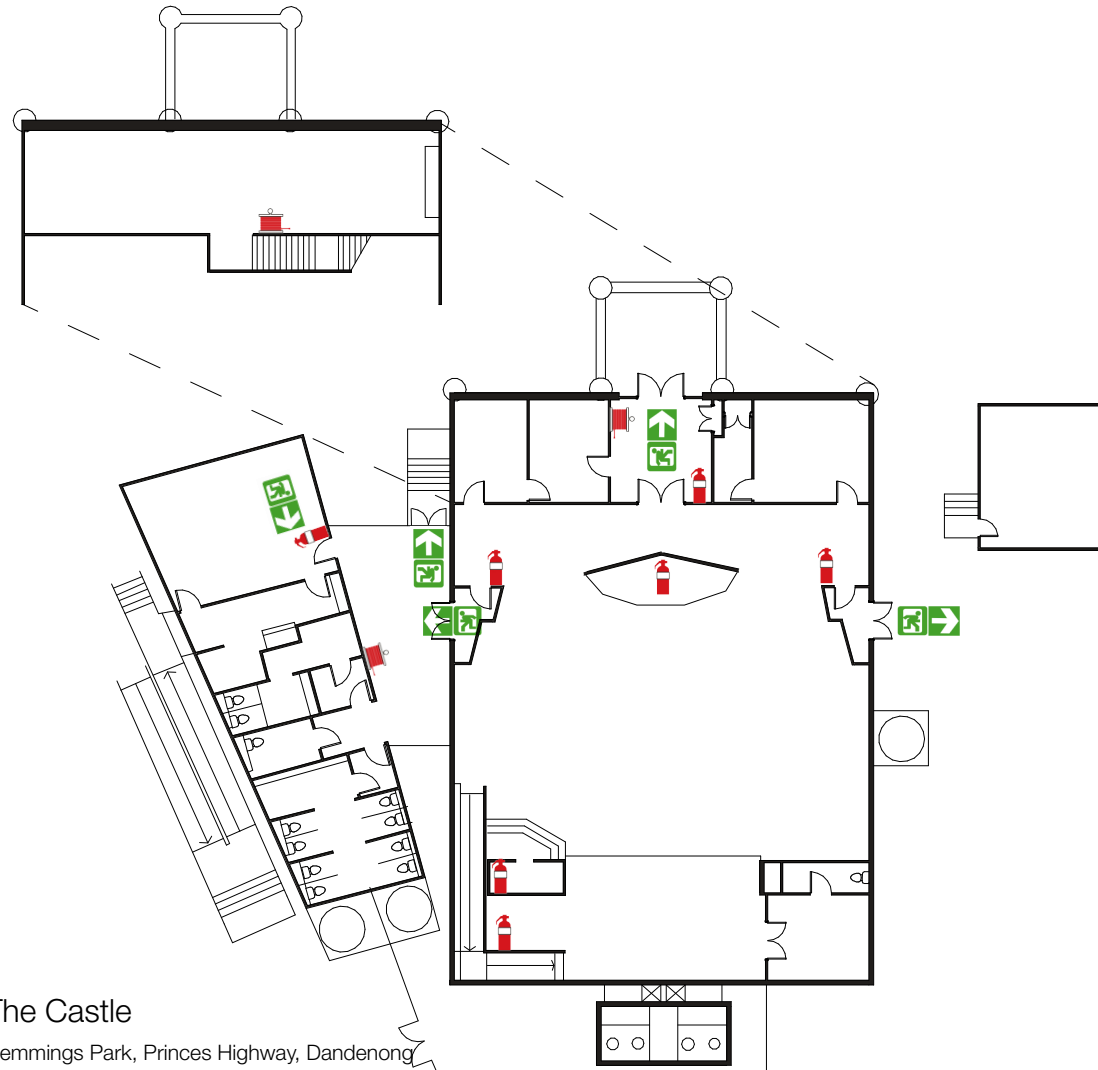

FIRE HOSE REEL



FIRE BLANKET



FIRE EXTINGUISHER



FIRE HYDRANT



FIRE INDICATOR PANEL



EMERGENCY EXIT



ASSEMBLY AREA